

Please read this document carefully before using this product. The guarantee will be invalidated if the device is damaged by not following instructions detailed in the manual. The company shall not be responsible for any damage or losses however caused, which may be experienced as a result of the installation or use of this product.

ET5412 TEMPERATURE CONTROLLER

Thank you for choosing **ET5412** temperature controller.



Compliant



- * 54x94mm sized
- * On-Off control.
- * Relay output for cooling or heating control.
- * Relay output for Alarm
- * Single NTC probe input.
- * Offset value can be entered for NTC probe.
- * In the case of probe failure, output state can be selected as on, off or periodical running.
- * Upper and lower limits of the setpoint can be adjusted.
- * Upper and lower alarm limits can be adjusted to dependent on the setpoint value.
- * Temperature unit can be selected as °C or °F.
- * Communication feature over RS485 ModBus protocol (optional).
- * CE marked according to European Norms.

ORDER CODE: ET5412-___ - ___ - __ _ 3

1 - Supply Voltage

230.....230V AC 110.....110V AC

2424V AC/DC 1212V AC/DC

SM......9-30V DC/7-24V AC

3-Out Bos.... 8A Relay Out

P...... 20A Relay Out

3 - ModBus

RS......ModBus (Optional)



ENDA ET5412 is a rail mounted device. Make sure that the device is used only for intended purpose. The electrical connections must be carried out by a qualified staff and must be according to the relevant locally applicable regulations. During an installation, all of the cables that are connected to the device must be free of electrical power. The device must be protected against inadmissible humidity, vibrations, severe soiling and make sure that the operation temperature is not exceeded. The cables should not be close to the power cables or components.

CONNECTION DIAGRAM





Equipment is protected throughout by DOUBLE INSULATION










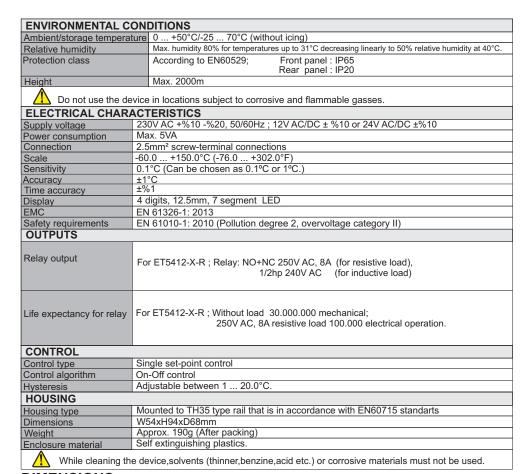

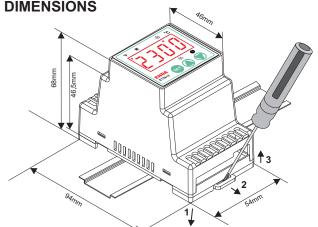

To mounting the device to the panel; Push the device in direction 1, the rails provide the key to keeping the rail.


To removing the device from rail; Push the rail lock in direction 2 with a screwdriver and pull the device in direction 3.



SİSEL MÜHENDİSLİK ELEKTRONİK SAN. VE TİC. A.Ş. Şerifali Mah, Barbaros Cad. No:18 Y.Dudullu 34775 ÜMRANİYEİSTANBUL-TÜRKEY Tel:+90 216 499 46 64 Pbx. Fax:+90 216 365 74 01



1/3 ET5412-EN-02-181120

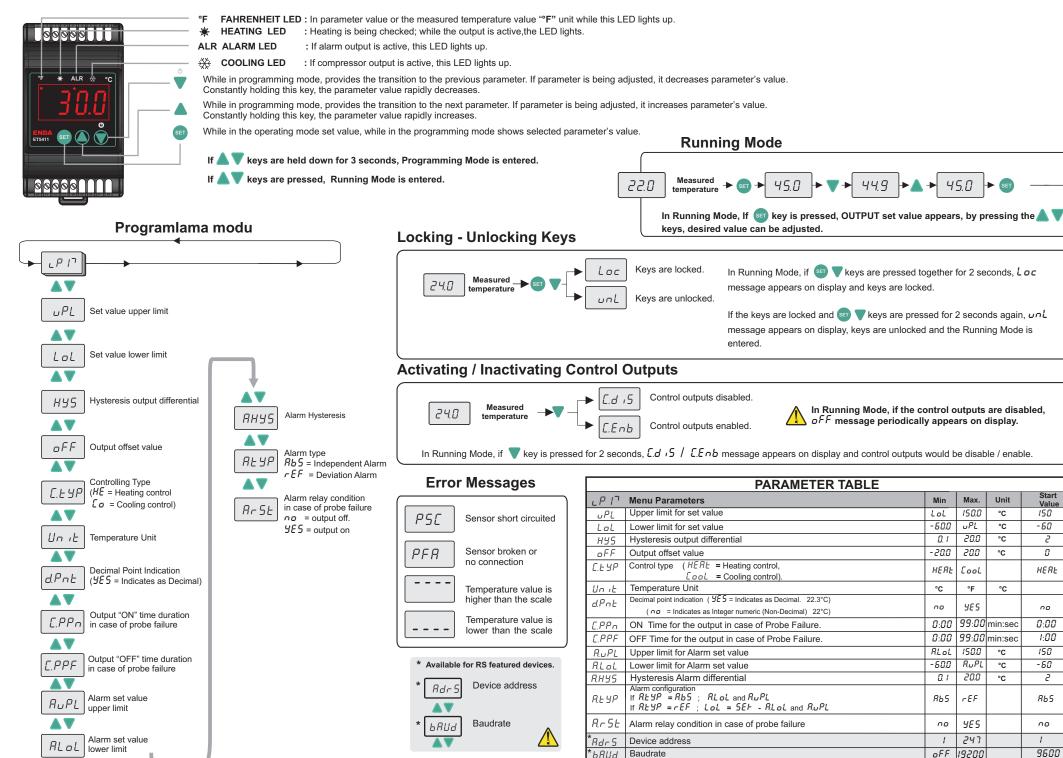

2/3 ET5412-EN-02-181120

Start

Value

150

-60

2

0

HERL

nn

0:00

1:00

150

-60

2

R_bS

nο

9600

°C

°C

ENDA ET5412 DIGITAL THERMOSTAT MODBUS PROTOCOL ADDRESS MAP								
1.1 HOLDING REGISTERS								
Holding Register Addresses		Data	Data Content	Parameter	Read/Write Permission	Status Value		
Decimal	Hex	Type		Name	1 61111331011	value		
0000d	0x0000	word	Set value		Readable/Writeable	45		
0001d	0x0001	word	Set point value upper limit	υPL	Readable/Writeable	150		
0002d	0x0002	word	Alarm set point value upper limit	AuPL	Readable/Writeable	-60		
0003d	0x0003	word	Set point value lower limit	LoL	Readable/Writeable			
0004d	0x0004	word	Alarm set point value lower limit	ALoL	Readable/Writeable			
0005d	0x0005	word	Offset value	oFF	Readable/Writeable	0		
0006d	0x0006	word	Output hysteresis	HY5	Readable/Writeable	О		
0007d	0x0007	word	Alarm output hysteresis	AHY5	Readable/Writeable	0		
0008d	0x0008	word	ON Time for the output in case of Probe Failure.	C.PPn	Readable/Writeable	∅:∅∅(0 sec)		
0009d	0x0009	word	OFF Time for the output in case of Probe Failure.	C.PPF	Readable/Writeable	/:@@(60 sec)		
0010d	0x0010	word	Address value	Adr5	Readable/Writeable	1		

1.2 INPUT REGISTERS								
Input Register Addresses		Data Type	Data Content	Parameter Name	Read/Write Permission			
Decimal	Hex	туре		Name	Permission			
0000d	0x0000	word	Measured temperature value (°C / °F)					

bRud

Readable/Writeable



0011d

0x0011

word


Temperature value is read as "Input Register" parameter and this value with decimal part defined as a signed integer. (That is "23.5 $^{\circ}$ C" temperature will be at "235" value).

Baudrate (0=Off;1=1200;2=2400; 3=4800; 4=9600; 5=19200)

1.3 DISCRETE INPUTS							
Discrete Input Addresses		Data Type	D (0) (Read/Write Permission		
Decimal	Hex	31		Name	r emilission		
0000d	0x00	Bit	Control output state (0 = OFF; 1 = ON)		Read only		
0001d	0x01	Bit	Alarm output state (0 = OFF; 1 = ON)		Read only		

1.4 COILS								
Coil Addresses		Data	Data Content	Parameter Name	Read/Write	Status		
Decimal	Hex	Туре		Name	Permission	Value		
00d	0x00	Bit	Control type selection. OFF=Cooling control (\mathcal{E}_{σ}) ON=Heating control ($\mathcal{H}\mathcal{E}$)	C.E 4P	Readable/Writeable	[o		
01d	0x01	Bit	Temperature unit. OFF = °C , ON = °F	Un ıE	Readable/Writeable	٥٢		
02d	0x02	Bit	Decimal point . OFF = no , ON = 455	d.PnE	Readable/Writeable	no		
03d	0x03	Bit	Alarm configuration OFF = 865 ON = 65	ALYP	Readable/Writeable	A 6 5		
04d	0x04	Bit	Alarm relay condition in case of probe failure OFF = no ON = 45	Ar5E	Readable/Writeable	no		

MODBUS COMMUNICATION PARAMETERS									
Adrs	Device address for RS485 network connection. Adjustable between 1-247.	1	247	-	1				
PURG	Baudrate (0=Off;1=1200;2=2400; 3=4800; 4=9600; 5=19200)	oFF	19.20	-	9600				

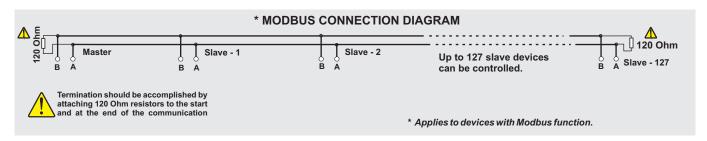





9600